

WIDTH "W"	SIDEROOM "X1"	SIDEROOM "X2"
0 - 4499	183	183
4500 - 6499	208	208

SIZE OF BLAZEGUARD 2000	CLEARANCE OF GUIDE FROM FLOOR "C"
BELOW 3000 clear width & 3000 clear height	0 CLEARANCE UPWARDS ALLOW FOR 10mm TOL LINEAR METRE IN HEIGHT
ABOVE 3000 clear width OR 3000 clear height	EXPANSION DOWNWARDS ALLOW FOR 10mm TOL LINEAR METRE IN HEIGHT

CLEAR HEIGHT "H" (NORMAL COLL)	HEADROOM "A" (NORMAL COLL)	HEADROOM "B1"
0 - 3499	450	600
3500 - 4749	500	600
4750 - 5999	550	675
6000 - 6499	600	850

ORDER No.:- _____

HANDING:- _____ L/H, R/H


(right hand shown).

QUANTITY:- _____

MISC.:- _____

SURROUNDING STRUCTURE:-

This must be a fire-resistant separating element (to B.S.476 PART 20,21,22: 1987) & have a fire resistance > or = to the doorset itself.
STEEL: the L.P.C recommends, that a critical temperature of 400° C and steel sections with an Hp/A value below 230mm² are used for designing fire resistant steel supporting structures.
 Only steel supporting structures designed to these parameters are considered by the Loss Prevention Council to be suitable for supporting roller shutters.
FIXING TO STEELWORK:-
 The guide fixing angles can be fixed directly to the st/wrk & the fire protection protecting the st/wrk applied over the section of guide fixing angle attached to the st/wrk, or, where the protection thickness is 25mm or less, the guide fixing angles can be applied over the fire protection; in the latter case the fixings must be packed out by the thickness of the material by a steel collar having a diameter of 25mm.

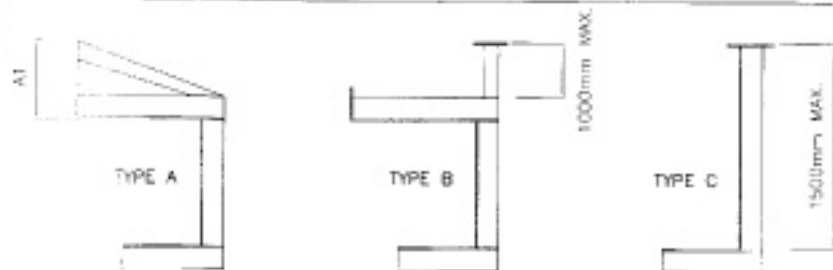

CANOPY/BARREL SUPPORT BRACKETS ARE SUPPLIED ON ALL DOORS ABOVE 2200mm.
 PLEASE SPECIFY WHICH TYPE OF BRACKET YOU REQUIRE.
 IF TYPE B OR TYPE C SPECIFIED, PLEASE STATE HEADROOM DIMENSION.

OPNG. SIZE (W X H) UPTO	TYPE A	QUANTITY REQUIRED
	A1	
CHAIN OP.		
3000 X 3000	325	1
4500 X 4250	372	2
5000 X 5000	378	3
ELEC OP.		
3000 X 3000	325	1
4500 X 4250	372	2
5000 X 5000	378	3
6000 X 5000	378	5
7000 X 6499	430	6

CANOPY/BARREL SUPPORT BKT:
 The barrel support brackets should be fixed symmetrically with respect to the opening centreline.

ZONE	REV	DESCRIPTION	DATE	APPROVED
BC	H	ALTERED TO GAROG MOTOR DETAILS	27/12/07	27/12/07
		CLIENT / SITE		
		DESCRIPTION		
		INDUPART ELECTRIC OPERATED BLAZEGUARD 2008 FACE FIX STEEL GENERAL ARRANGEMENT DETAILS		
		SIZE	CONTRACT No.	DWG NO.
		J		BG113 / 02 (G.A)
OWN BY:		S.B./J.E	DATE:	REV
				H